

GAS-FIRED WATER HEATER SCHEDULE																	
TAG	BASIS-OF-DESIGN	TYPE	LOCATION	CAPACITY GAL	RECOVERY GPH	TEMP RISE DEG-F	FUEL GAS		VENTING		ELECTRICAL DATA				WEIGHT LBS	REFERENCE NOTES	
							DEMAND CFH	INPUT BTUH	INLET NPS	OUTLET NPS	TYPE	VOLTS	PHASE	HERTZ			FLA
WH-11	AO SMITH BTH-199	HIGH EFFICIENCY STORAGE TANK	111	100	294	80	199	199	4	4	PVC	120	1	60	5	1400	1, 2, 3
SCHEDULE GENERAL NOTES: 1. PROVIDE PRODUCT INDICATED OR A COMPARABLE PRODUCT BY ONE OF THE MANUFACTURERS LISTED IN SPECIFICATION SECTIONS 15486. 2. WEIGHTS ARE APPROXIMATE AND INCLUDE WEIGHT OF WATER.																	
SCHEDULE REFERENCE NOTES: 1. PROVIDE CONCENTRIC VENT KIT. 2. PROVIDE CONDENSATE NEUTRALIZATION KIT. 3. PROVIDE UNIT CAPABLE OF OPERATING ON LP GAS.																	


RECIRCULATING PUMP SCHEDULE														
TAG	BASIS-OF-DESIGN	TYPE	LOCATION	FLOW RATE GPM	HEAD FT	SUCTION SIZE INCHES	DISCHARGE SIZE INCHES	MOTOR WATTS	MOTOR RPM	ELECTRICAL DATA				REFERENCE NOTES
										VOLTS	PHASE	HERTZ	FLA	
CP-1	BELL & GOSSETT NBF-12	LEAD-FREE BRONZE INLINE CIRCULATOR	111	3	10	3/4	3/4	55	2800	120	1	60	0.48	1, 2
SCHEDULE GENERAL NOTES: 1. PROVIDE PRODUCT INDICATED OR A COMPARABLE PRODUCT BY ONE OF THE MANUFACTURERS LISTED IN SPECIFICATION SECTIONS 221123.														
SCHEDULE REFERENCE NOTES: 1. PROVIDE UNIT WITH IMMERSION TYPE THERMOSTAT FOR CIRCULATOR PUMP CONTROL. 2. PROVIDE UNIT WITH ADJUSTABLE TIMER.														

EXPANSION TANK SCHEDULE									
TAG	BASIS-OF-DESIGN	TYPE	LOCATION	PRESSURE RATING PSIG	VOLUME GAL	ACCEPTANCE GAL	DIAMETER INCHES	HEIGHT INCHES	REFERENCE NOTES
ET-1	WESSELS T-12	DIAPHRAGM	111	150	4.8	2.9	7.9	10.8	-

PLUMBING FIXTURE SCHEDULE											
TAG	DESCRIPTION	FIXTURE DATA		FAUCET / VALVE DATA		FLOW RATE	MINIMUM RUNOUT SIZE				REFERENCE NOTES
		BASIS-OF-DESIGN	MOUNTING	BASIS-OF-DESIGN	TYPE		CW	HW	SAN	VENT	
D-1	OWNER FURNISHED COMMERCIAL FOOD WASTE DISPOSER	INSINKERATOR SS-200	#5 SINK FLANGE KIT	-	-	5 GPM	1/2	-	2	1 1/2	1
KS-1	OWNER FURNISHED STAINLESS STEEL HANDWASH SINK	ADVANCE TABCO 7-PS-68	WALL-MOUNTING WITH CARRIER	INCLUDED WITH SINK	MANUAL, WRIST BLADE	1.0 GPM	1/2	1/2	2	1 1/2	2
KS-2	OWNER FURNISHED STAINLESS STEEL PREP SINK	ADVANCE TABCO CO-1416A-10RE	UNDER MOUNT	T&S BRASS B-1141-04-CR WITH B-0199-01-F15 AERATOR	MANUAL, WRIST BLADE	1.5 GPM	1/2	1/2	2	1 1/2	4, 5
KS-3	OWNER FURNISHED THREE COMPARTMENT STAINLESS STEEL POT SINK	ADVANCE TABCO 93-3-54-24RL	FLOOR MOUNTED FREESTANDING	T&S BRASS B-0133-12-CR8BP	MANUAL, LEVER W/ PRE-RINSE SPRAY	1.07 GPM SPRAY	3/4	3/4	3	1 1/2	3
KS-4	OWNER FURNISHED PRE-RINSE SINK IN SOILED DISH TABLE	FURNISHED BY OWNER INSTALLED BY PLUMBER	FLOOR	T&S BRASS B-0133-12-CR8BP	MANUAL, LEVER W/ PRE-RINSE SPRAY	1.07 GPM SPRAY	3/4	3/4	3	1 1/2	
KS-5	OWNER FURNISHED TWO COMPARTMENT STAINLESS STEEL PREP SINK	ADVANCE TABCO 93-22-40	FLOOR MOUNTED FREESTANDING	T&S BRASS B-2463 WITH B-0199-01 AERATOR	MANUAL, WRIST BLADE	2.2 GPM	3/4	3/4	3	1 1/2	3
PF-1	OWNER FURNISHED POT FILLER	-	-	T&S BRASS B-0605	MANUAL, WRIST BLADE	3.06 GPM	3/4	-	-	-	
SCHEDULE GENERAL NOTES: 1. PROVIDE PRODUCT INDICATED OR A COMPARABLE PRODUCT BY ONE OF THE MANUFACTURERS LISTED IN SPECIFICATION SECTIONS 224213, 224214, 224216, 224217, 224223, 224500, 224600, AND 224716. 2. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS OF ACCESSIBLE FIXTURES. ADJUST MOUNTING HEIGHTS FOR WALL-MOUNTING FIXTURES AS NECESSARY. 3. PROVIDE FLOOR-MOUNTING FIXTURE CARRIERS FOR ALL WALL-MOUNTING FIXTURES. 4. PROVIDE ALL APPURTENANCES AS NECESSARY FOR COMPLETE INSTALLATION OF PLUMBING FIXTURES. 5. PROVIDE INSULATED COVERS FOR EXPOSED SUPPLIES AND TRAPS ON ACCESSIBLE FIXTURES. 6. ALL FIXTURES TO BE FURNISHED BY THE OWNER ARE TO BE INSTALLED BY THE PLUMBING CONTRACTOR. PLUMBING CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING SUPPLIES, DRAINS, P-TRAPS, ETC. REQUIRED FOR COMPLETE INSTALLATION. SCHEDULE REFERENCE NOTES: 1. UNIT FURNISHED WITH AQUA SAVER CONTROL CENTER AND LOW FLOW OPTION. ELECTRICAL CHARACTERISTICS 2HP AT 208V-3 PHASE. 2. PROVIDE TMV-1 SET TO 105 DEGREES-F. 3. INSTALL OWNER FURNISHED TWIST DRAIN AND PROVIDE INDIRECT WASTE PIPING FOR EACH COMPARTMENT TO FLOOR SINK. 4. PROVIDE TMV-1 SET TO 120 DEGREES-F. 5. PROVIDE GRID DRAIN AND INDIRECT WASTE PIPING TO FLOOR SINK.											

DRAINAGE SPECIALTIES SCHEDULE			
TAG	BASIS OF DESIGN	DESCRIPTION	REFERENCE NOTES
FCO-1	SIoux CHIEF 834 SERIES	PVC FLOOR CLEAN OUT WITH MEDIUM DUTY, SQUARE, STAINLESS STEEL TOP	
FD-1	SIoux CHIEF 833 SERIES	PVC FLOOR DRAIN WITH SQUARE, LIGHT DUTY, STAINLESS STEEL GRATE AND STRAINER.	1, 2
FS-1	SIoux CHIEF 861 SERIES	SQUARE, PVC FLOOR SINK WITH MEDIUM DUTY, STAINLESS STEEL HALF GRATE AND STAINLESS STEEL MESH DEBRIS BASKET	1, 2
GH-1	SCHIER GB-75	POLYETHYLENE GREASE INTERCEPTOR WITH H20 RATED, PICKABLE CAST IRON COVER	3, 5
SH-1	SCHIER SH-75	POLYETHYLENE SOLIDS INTERCEPTOR WITH H20 RATED, PICKABLE CAST IRON COVER	3, 5
SM-1	SCHIER SV24-L	POLYETHYLENE WASTEWATER SAMPLING PORT WITH H20 RATED PICKABLE CAST IRON COVER	3, 4
WCO	SIoux CHIEF 873 SERIES	WALL CLEANOUT COVER PLATE	6
YCO-1	SIoux CHIEF 850 SERIES	HEAVY DUTY, CAST IRON CLEAN OUT COVER	4
SCHEDULE GENERAL NOTES 1. REFER TO SPECIFICATION SECTION 221319 AND 221423. 2. COMPLY WITH MANUFACTURERS' RECOMMENDED INSTALLATION INSTRUCTIONS.			
SCHEDULE REFERENCE NOTES 1. PROVIDE SEDIMENT BASKET. 2. PROVIDE BARRIER-TYPE, TRAP-SEAL PROTECTION DEVICE 3. PROVIDE EXTENSIONS AS NECESSARY FOR COVER TO BE FLUSH WITH SURROUNDING GRADE. 4. INSTALL IN A MINIMUM OF 24 INCH SQUARE CONCRETE PAD PER MANUFACTURERS RECOMMENDATIONS. 5. INSTALL COVER IN A MINIMUM OF 36 INCH SQUARE CONCRETE PAD. 6. PROVIDE MOUNTING SCREW OF NECESSARY LENGTH. MOUNTING SCREW SHALL NOT FULLY PENETRATE CLEANOUT PLUG.			

DOMESTIC WATER SPECIALTIES SCHEDULE			
TAG	BASIS OF DESIGN	DESCRIPTION	REFERENCE NOTES
DCV-1	WATTS SD-2	DUAL-CHECK BACKFLOW PREVENTER	4
OB-1	SIoux CHIEF 696 SERIES	ABS OUTLET BOX WITH SHUT-OFF VALVE	1, 2
PRV-1	WATTS LF123LP	LEAD FREE BRONZE WATER PRESSURE REDUCING VALVE	
RP-1	WATTS SS-009-QT-S	STAINLESS STEEL, REDUCED-PRESSURE-PRINCIPLE BACKFLOW PREVENTION ASSEMBLY WITH 1/4-TURN BALL VALVES AND STRAINER	3, 4
TMV-1	POWERS LF6480	INDIVIDUAL-FIXTURE, ADJUSTABLE THERMOSTATIC WATER TEMPERING VALVE	
WHA	SIoux CHIEF HYDRARESTER	WATER HAMMER ARRESTER WITH COPPER TUBE AND PISTON	5
SCHEDULE GENERAL NOTES 1. REFER TO SPECIFICATION SECTION 221119. 2. COMPLY WITH MANUFACTURERS' RECOMMENDED INSTALLATION INSTRUCTIONS.			
SCHEDULE REFERENCE NOTES 1. PROVIDE DCV-1 ON OUTLET PRIOR TO CONNECTION TO BEVERAGE EQUIPMENT. 2. MOUNT OUTLET BOX 2 INCHES ABOVE COUNTER BACKSPLASH. 3. INSTALL UNIT WITH ORIENTATION PER MANUFACTURER'S RECOMMENDATIONS AND IN ACCORDANCE WITH AHJ. 4. PROVIDE UNIT WITH AIR-GAP FITTING AND ROUTE INDIRECT DRAIN TO NEAREST RECEPTOR. 5. PROVIDE UNIT SIZES (AA, A, B, C, D, E, F) AS INDICATED IN ISOMETRICS.			

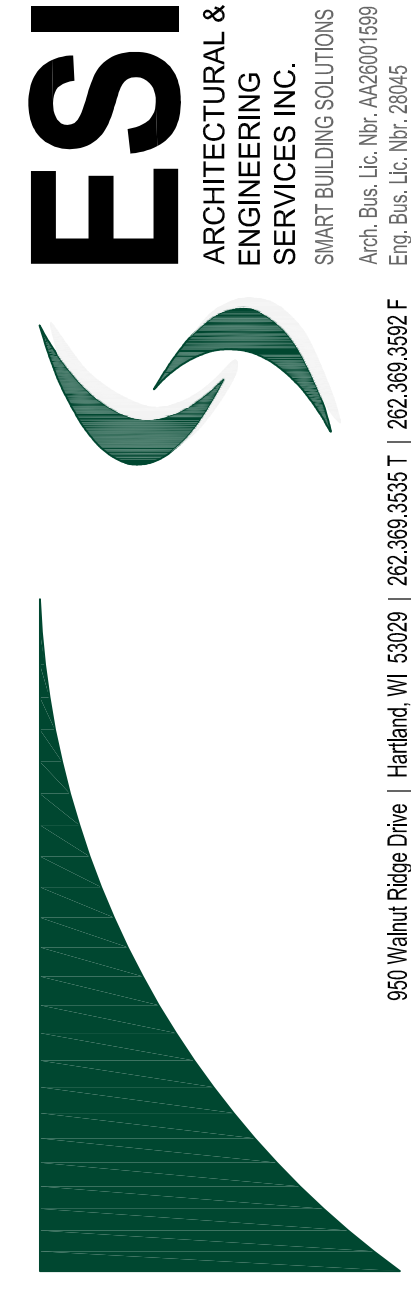

KITCHEN RENOVATION FOR
US FOODS - SOUTH FLORIDA
7598 NW 6TH AVENUE
BOCA RATON, FL 33487

REVISIONS	
△	-
△	-
△	-
△	-
△	-
△	-
△	-
△	-
△	-

DATE 1-6-20	JOB NO. 50-1414-19
DWG BY AMK	CHKD BY AMK

SHEET TITLE
SCHEDULES

PRELIMINARY DWGS.	
FINAL CONST. DWGS.	■
SHEET NUMBER	

P801
PLUMBING