


- GENERAL NOTES
- SEE APPLICABLE NOTES ON SHEET E001.
 - RELOCATE, REPLACE AND REWORK EXISTING ELECTRICAL, FIRE ALARM, SECURITY, COMMUNICATIONS AND CONTROL SYSTEMS AS REQUIRED TO MAINTAIN SYSTEM INTEGRITY IN ALL RENOVATED AREAS.
 - REMOVE EXISTING ABANDONED LOW VOLTAGE CABLING, VOICE AND DATA CABLE TO BE REMOVED FROM JACK TO PATCH PANEL IN EXISTING SERVER ROOM.

- KEY NOTES - THIS SHEET ONLY
- DISCONNECT AND REMOVE ELECTRICAL OUTLETS AND HARD WIRED CONNECTIONS TO ALL KITCHEN EQUIPMENT IN THIS AREA.
 - TEMPORARILY SUSPEND SECURITY SYSTEM SENSORS AND REINSTALL IN NEW CEILING TILE. TYPICAL OF (2).
 - REMOVE AV EQUIPMENT CABINET. TURN EQUIPMENT OVER TO OWNER.
 - FURNITURE SYSTEM POWER FEED TO BE REMOVED. TYPICAL OF (7).
 - FURNITURE SYSTEM TELECOMMUNICATIONS FEED TO BE REMOVED. TYPICAL OF (7).

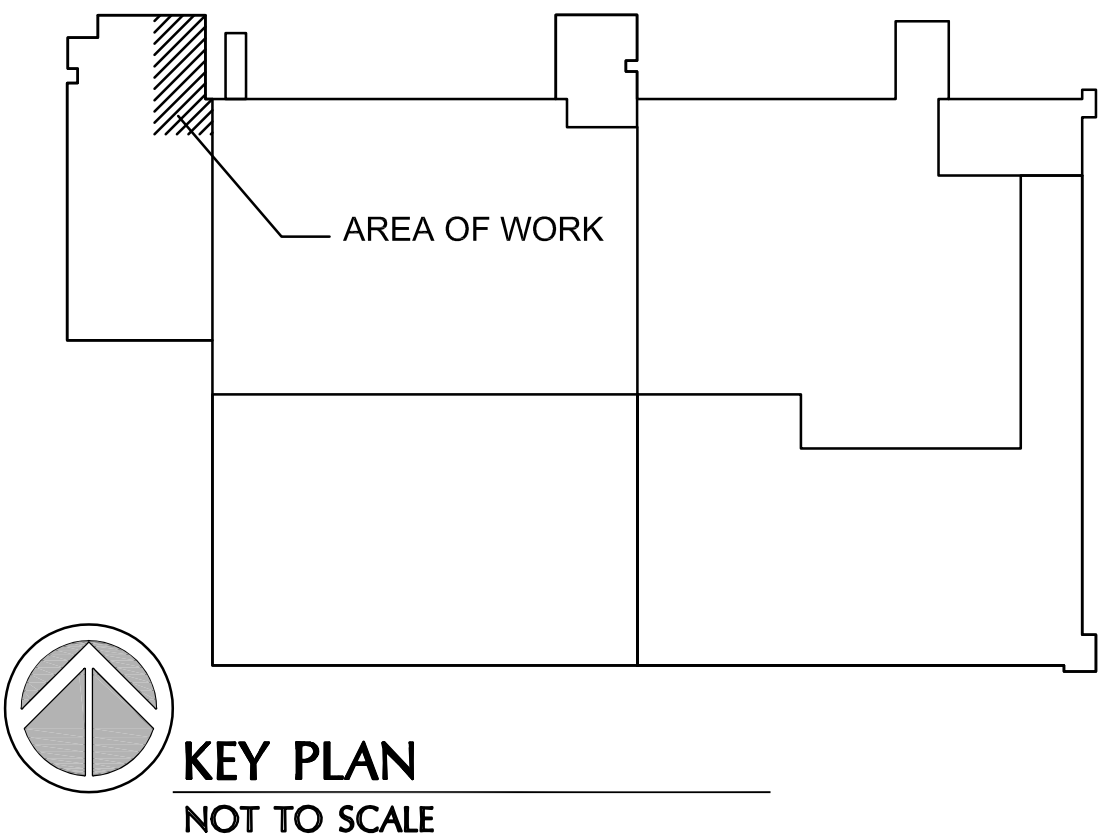

REVISIONS	
△	-
△	-
△	-
△	-
△	-
△	-
△	-
△	-

DATE 1-6-20	JOB NO. 50-1414-19
DWG By EGP	CHKD By TJM

SHEET TITLE
DEMOLITION

PRELIMINARY DWGS.	
FINAL CONST. DWGS.	■
SHEET NUMBER	