

RESTRAINT JOINTS


PIPE DIAMETER	D.I.P. Restraint limits (ft) either side of the following fittings.			
	22.5"	45"	90"	Dead Ends
4"	5	10	25	35
6"	7	14	35	49
8"	9	19	45	64
10"	11	22	54	77
12"	13	26	64	90
16"	16	34	82	115
20"	20	41	99	140
24"	23	48	116	162
30"	28	57	139	194
PVC	Restraint limits (ft) either side of the following fittings.			
	22.5"	45"	90"	Dead Ends
4"	7	14	33	55
6"	9	19	46	77
8"	12	25	61	101
10"	15	30	73	121
12"	17	36	86	143
16"	22	46	111	183

ALL PRESSURE PIPE FITTINGS SHALL CONTAIN MEGALUG DEVICES WITH A WORKING PRESSURE OF 250 PSI ON EACH SIDE OF THE FITTING IN ACCORDANCE WITH THE CHART ABOVE IN ACCORDANCE WITH THE COWH TECHNICAL SPECIFICATIONS, SECTION 3.8 PIPE RESTRAINT REQUIREMENTS.

C.O.W.H. WATER DETAILS

WESTWOOD AT WINTER HAVEN
A MULTI-FAMILY COMMUNITY
WINTER HAVEN, FLORIDA

CARTER
ENGINEERING
137 5th. St. N.W., Winter Haven Fl. 33881
(863) 294-6965 * E-mail: clave@carter-eng.com

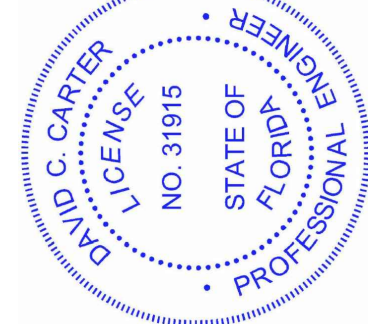

DAVID C. CARTER, P.E.
PROFESSIONAL ENGINEER
NO. 31915
THIS SEAL IS VALID FOR THE TERM OF 5 YEARS
ISSUED AND SEALED BY
DAVID C. CARTER, P.E.
ON 10/7/19
SIGNATURE PRINTED
COPIES OF THIS SEAL
CONSIDERED VOID
UNLESS SIGNED
DIGITAL SIGNATURE
ANY ELECTRONIC
COPIES

DRAWN BY:
DESIGNED BY:
CHECKED BY:
D.C.C.
ISSUE DATE:
FIELD DATE:

NO.	DATE	APPR.	REVISIONS

PROJECT No.	SHEET #
278	D2.1
PLOT DATE	Oct. 09, 2019-12:06